


AQUECOIL Hydronic Heating Unit

Sample Installation Diagram Showing Connections to Tankless Water Heater and Domestic Water Supply





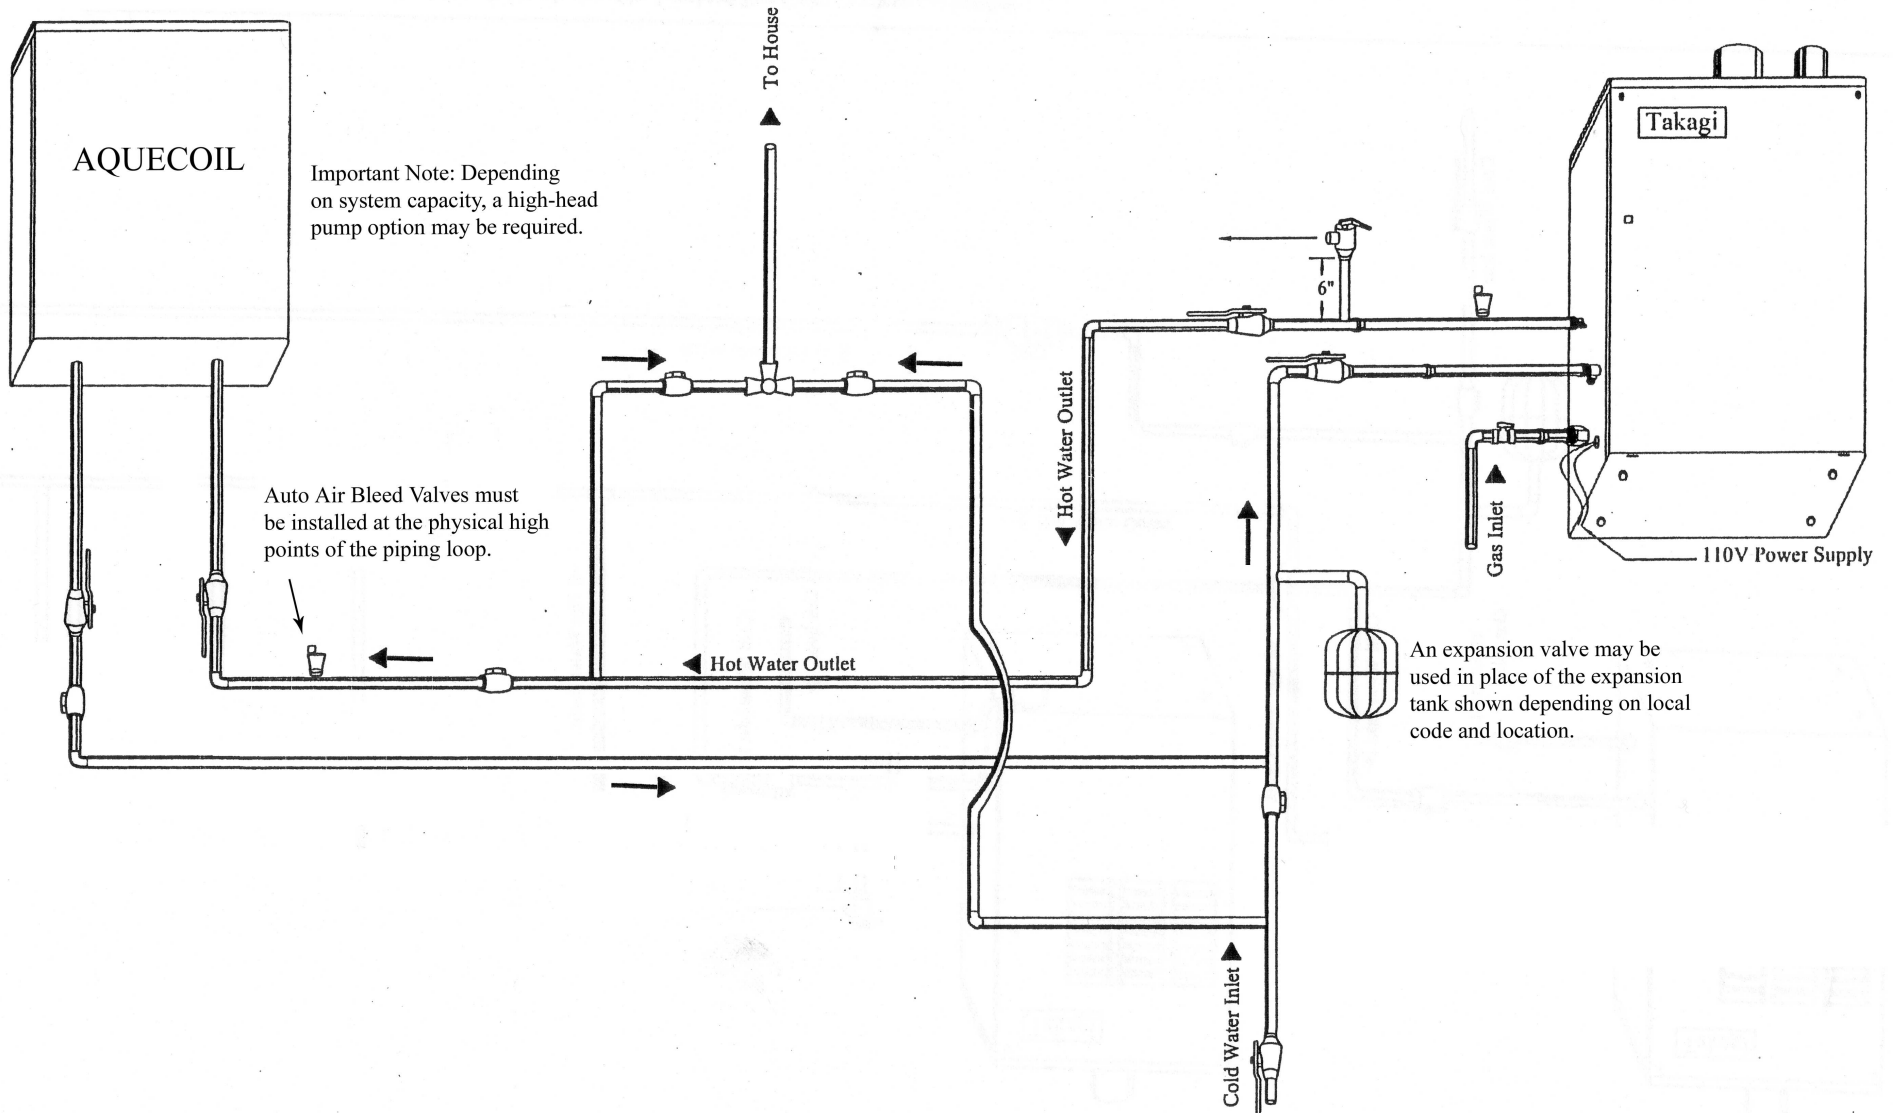




This diagram is provided as a courtesy by Takagi USA and has been modified by

BINDUS MANUFACTURING, LLC

for applications with the Aquecoil Hydronic Heating System.

Note: This drawing is intended as a basic guide. Local and State Codes dictate correct installation. Each individual application, gas pipe diameter, pump size, and expansion tank must be sized correctly.

	Min. Ø 3/4" Gas Shut-off Ball Valve		Pressure Relief Valve		Mixing Valve (ASSE 1017)		Auto Air Bleed Valve
	Water Shut-off Ball Valve w/ Bleed Port		Unions		Swing Check Valve		